


Note:

1. Compressor unit and ice maker are placed indoor, and their distance is less than 5m, Cooling tower outdoor,
2. Reserve more than 0.8m for service space.
3. Cooling tower installation-less than 10m away from unit, more than 1m higher away from unit.
4. Water pipes, cables and refrigeration pipe are connect to specific interface of our equipment.
5. Unless special introduction, according to Snowkey standard, other technical parameter is subject to actual situation.
6. The quality of cooling water should meet the requirements of GB50050 code.
7. The drawing layout is only for reference, equipment is subject to contract.

Technical parameter:

water in temp:	20°C
ambient temp:	33°C
wet bulb temp:	25°C
thickness:	about 10mm
production:	20t/24hr
power supply:	380V/50Hz/3P
refrigerant:	R507A/R404A
installation power:	about 95kW
water consumption:	about 0.84m ³ /hr

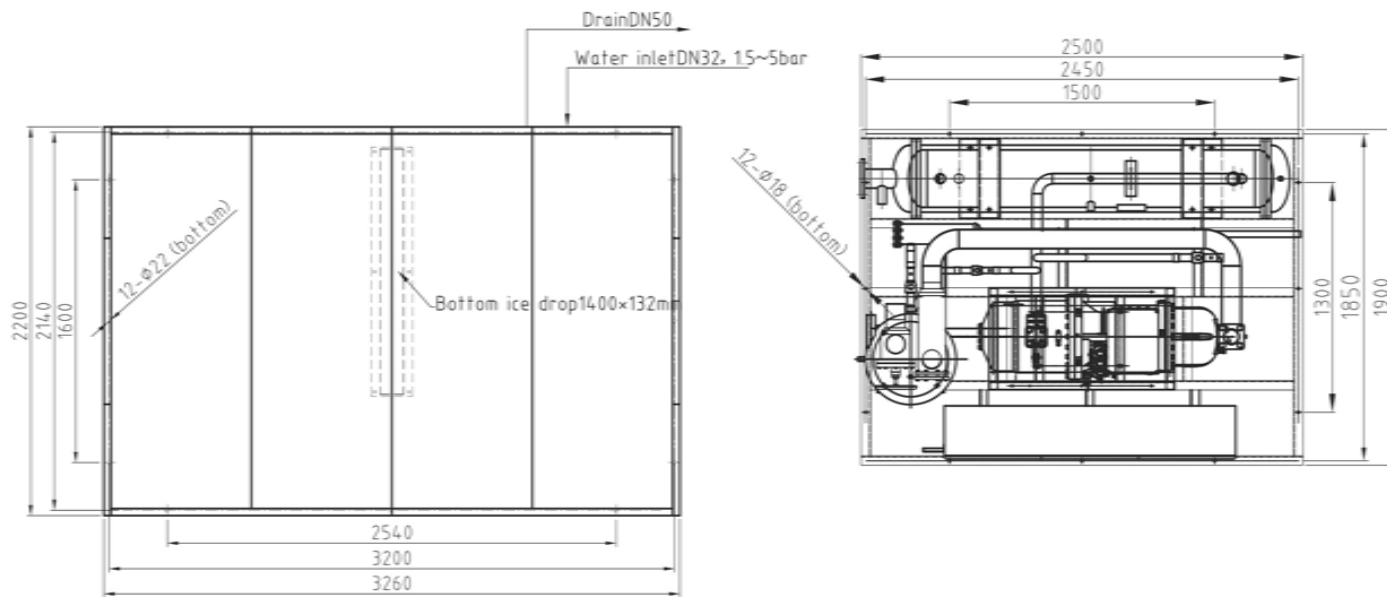

Item ref	Quantity	Title/Name, designation, material, dimension etc			Article No./Reference	
Designed by	Checked by	Approved by - date	Filename	Date	Scale	
				2019.09.17		
					Edition	Sheet
						1/1